LINEAR O-ATEX E

APPROVED IN ACCORDANCE WITH THE EUROPEAN STANDARD 94/9/EC - ATEX

These instruments, explosion-proof certified:

CESI 03 ATEX 272 Ext.2 1/2G Exd IIC T5/T6 G2/Gb, are used to control the level of liquids or fuels inside tanks, both underground and outdoors, installed in hazardous areas where flammable products are treated.

The principle of operation is potentiometric type, based on the gradual shutdown of a chain of resistors and reed contacts, placed inside of the measuring rod by a magnetic float.


GENERAL CHARACTERISTICS

- Brass Spansil Stainless steel rod
- Measuring resolution 5 10 20 mm.
- Potentiometric signal output (LC).
- 4-20mA analog output (LCT).
- Up to 6 m length depending on the used float.
- Maximum working pressure 20 Bar.

FLOATS

- Working ambient temperature. -40/+40°C = T6, -40/+60 °C = T5
- Standard working temperature up to 100°C. Execution up to 120°C on request.
- Minimum degree of protection IP65
- Built-in temperature sensors, on request. PT – PTC – NTC



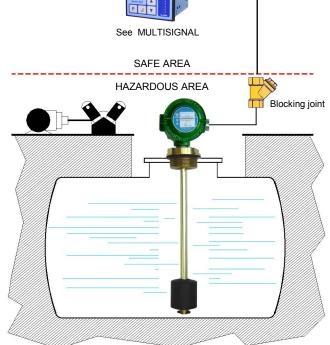

Tab.1




Exd

ELECTRICAL OUTPUT

Tab.2

Pressure

Temperature



Level

Flow

E1 IP65 Housing With heatsink - see dimension (*) LC – LCT = Temperature class M

Electronic


We reserve the right to change the data without notice





LINEAR O-ATEX E

Continuous level sensor

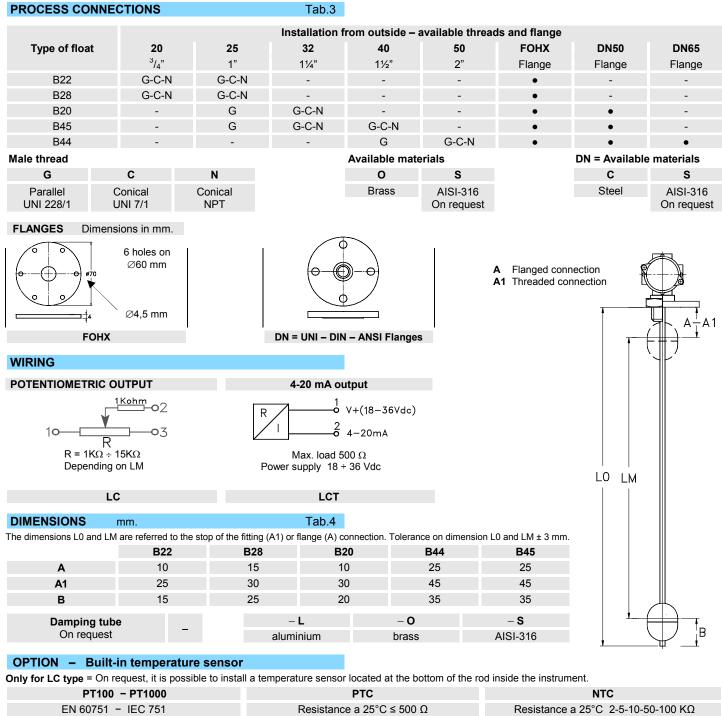

EN 80751 - TEC 751Resistance a 25 C \leq 500 Ω Resistance a 25 C \geq -5-10-50-100 RClass B - A (on request)Temperature 60°C \div 120°CPrecision \pm 5% / \pm 3% (on request)

NOMENCLATURE

Level

Flow

| С | B45 | 10 | 1300 / 1380 | S | $-\mathbf{L}$ | 25 | G | 0 | E1 | L | | |
|---|-----|----|-------------|---|---------------|----|---|---|----|---|-------|--|
| • | | | | | | | | | | | | |
| | • | | | | | | | | | | Tab.1 | |
| | | • | | | | | | | | | Tab.1 | |
| | | | • | | | | | | | | Tab.4 | |
| | | | | • | | | | | | | - | |
| | | | | | • | | | | | | Tab.4 | |
| | | | | | | • | | | | | Tab.3 | |
| | | | | | | | • | | | | Tab.3 | |
| | | | | | | | | • | | | Tab.3 | |
| | | | | | | | | | • | | Tab.2 | |
| | | | | | | | | | | • | Tab.1 | |

All level controls Exd certified must be connected by interposing the appropriate blocking joints according to the European Standard EN 50018. We reserve the right to change the data without notice BE#175

BE#179/1-01/2014



